
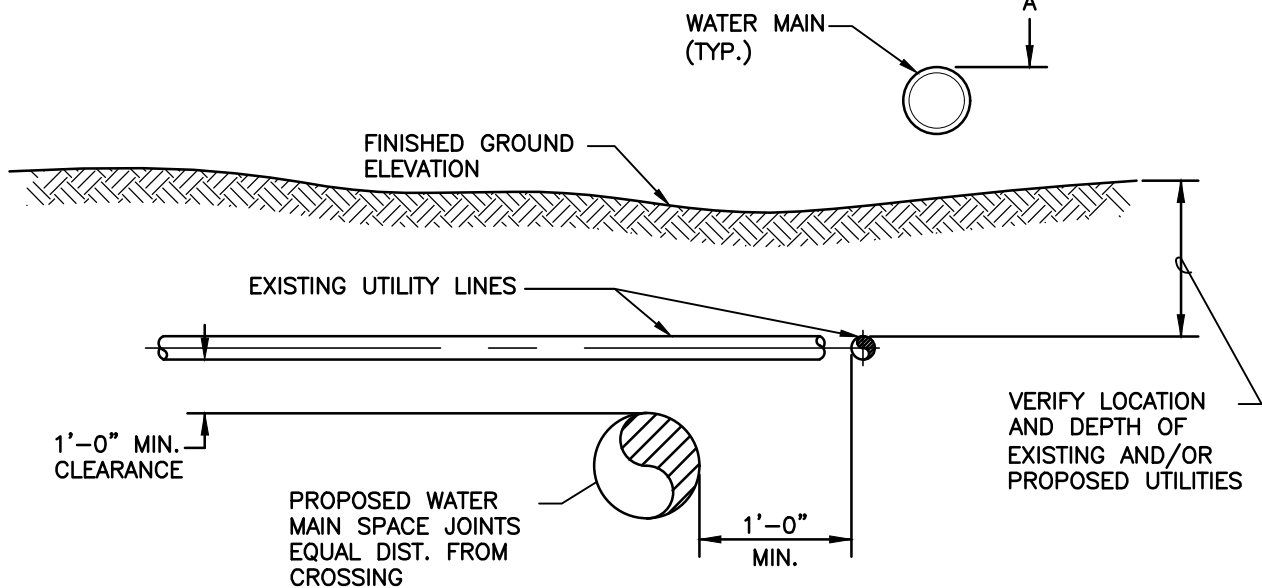


FILE NAME: \\K-FSI\LIBRARY\CAD\DETAILS\DISTRICTS\CROSS VALLEY WATER DISTRICT\WD-9.DWG

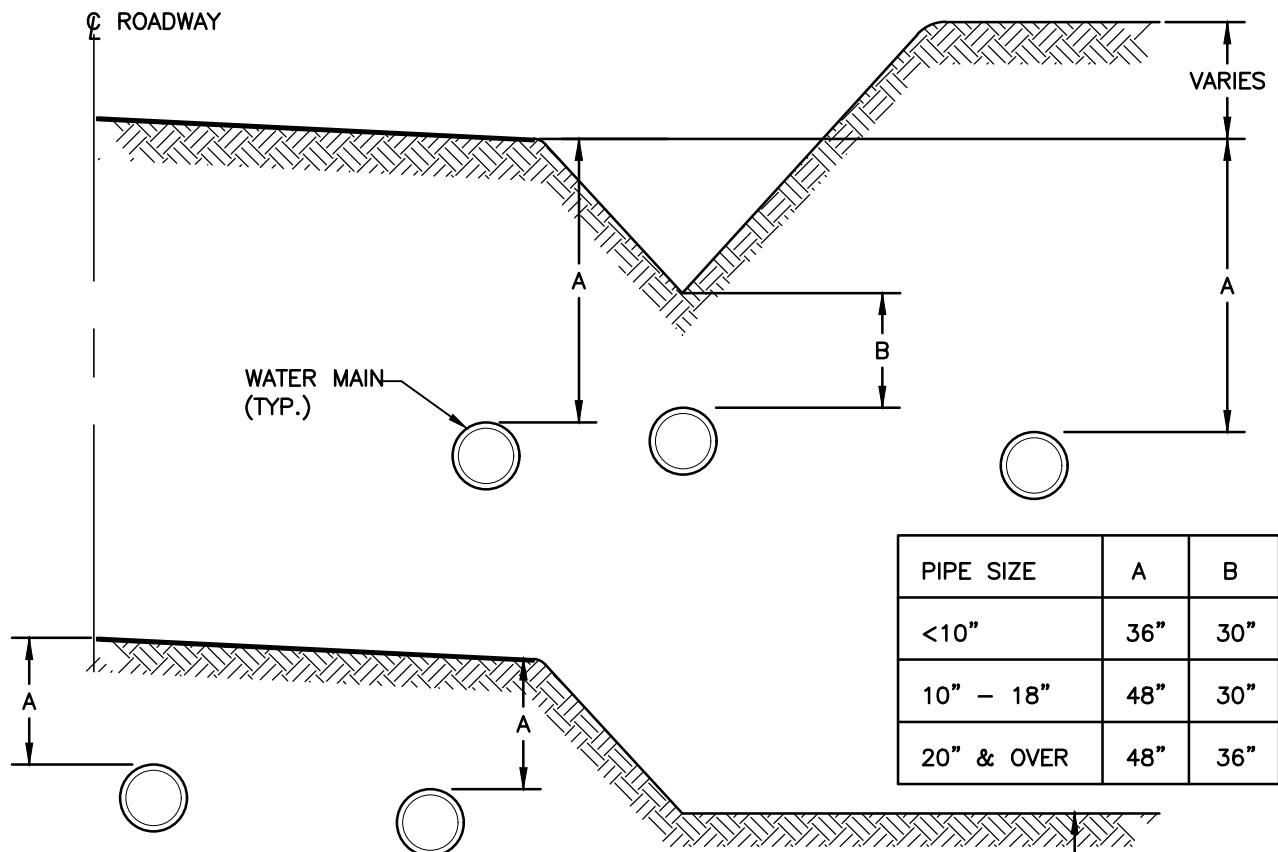

NOTES:

1. IN THE CASE OF CONFLICTS WITH OTHER UTILITIES, ROUTE WATER MAINS UNDER CONFLICTING UTILITIES. POTHOLING PRIOR TO INSTALLING WATER MAIN IS REQUIRED TO PROVIDE CONSISTENT LINE AND GRADE.
2. IN THE CASE OF CONFLICTS WITH SEWER LINES, FOLLOW ECOLOGY REQUIREMENTS OR AS DIRECTED.
3. MAIN TO BE INSTALLED AT CONSISTENT GRADE. MAXIMUM DEFLECTION SHALL BE 2 PERCENT AT EACH JOINT.

**CROSS VALLEY WATER DISTRICT
STANDARD WATER DETAILS**

**MINIMUM STANDARD DEPTH
REQUIREMENTS**

WD-9

NOT TO SCALE

JULY 2024